



REPUBLIC OF THE PHILIPPINES  
**PHILIPPINE STATISTICS AUTHORITY**

# CONSTRUCTION OF FIT-OUT AND LANDSCAPE WORKS FOR THE TWENTY-THREE (23) STOREY PHILIPPINE STATISTICS AUTHORITY (PSA) OFFICE BUILDING WITH COVERED ROOF DECK

PSA COMPLEX, EAST AVENUE, DILIMAN, QUEZON CITY

## DETAILED ARCHITECTURAL AND ENGINEERING DESIGN ( DAED )

### ELECTRICAL

**NOTE:**

PURSUANT TO SECTION 4 OF ANNEX "A" OF THE REVISED IMPLEMENTING RULES AND REGULATION OF R.A. 5184, APPROVAL BY THE AUTHORIZED DPWH OFFICIALS OF DETAILED ENGINEERING SURVEYS AND DESIGN UNDERTAKEN BY CONSULTANTS NEITHER DIMINISHES THE RESPONSIBILITY OF THE LATTER FOR THE TECHNICAL INTEGRITY OF THE SURVEYS AND DESIGN NOR TRANSFER ANY PART OF THAT RESPONSIBILITY TO THE APPROVING OFFICIALS.

THE DESIGN CONSULTANT SHALL BE HELD RESPONSIBLE FOR THE FAILURE OF THE FACILITY/ES / STRUCTURES DUE TO FAULTY DESIGN EXCEPT FOR THE CHANGES MADE WITHOUT THE CONFORMITY OF THE CONSULTANTS.

DRAWINGS AND SPECIFICATIONS DULY SIGNED, STAMPED OR SEALED, AS INSTRUMENTS OF SERVICE ARE PROPERTY AND DOCUMENTS OF THE ARCHITECT. WHETHER THE OBJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, IT SHALL BE UNLAWFUL FOR ANY PERSON, WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT OR AUTHOR OF SAID DOCUMENTS, TO DUPLICATE OR TO MAKE COPIES OF SAID DOCUMENTS FOR USE IN THE REPETITION OF AND FOR OTHER PROJECTS OF BUILDINGS, WHETHER EXECUTED PARTLY OR IN WHOLE.

**EE-01 GENERAL NOTES**

- ALL ELECTRICAL WORKS HEREIN INCLUDED IN ACCORDANCE WITH THE PROVISIONS OF THE LATEST EDITION OF THE PHILIPPINE ELECTRICAL CODE, THE RULES AND REGULATIONS OF THE LOCALITY AND THE REQUIREMENTS OF THE UTILITY POWER COMPANY.
- ALL ELECTRICAL WORKS HEREIN INCLUDED SHALL BE EXECUTED BY PERSONNEL WITH ELECTRICAL EXPERIENCE UNDER THE DIRECT SUPERVISION OF A FULL TIME REGISTERED ELECTRICAL ENGINEER. WORKS SHALL BE NEATLY PLACED, SECURELY FASTENED AND PROPERLY FINISHED.
- SERVICE ENTRANCE SHALL BE THREE-PHASE, FOUR WIRES PLUS GROUND, 34.5KV / 400VAC, 60Hz.
- THE CONTRACTOR SHALL VERIFY AND ORIENT THE ACTUAL LOCATION OF SERVICE ENTRANCE FOR CONNECTION TO POWER AND COMMUNICATION SUPPLY.
- MATERIALS SHALL BE NEW AND SHALL CONFORM WITH THE PROVISIONS OF THE UNDERWRITERS LABORATORIES INC., IN EVERY CASE WHERE SUCH A STANDARD HAS BEEN ESTABLISHED.
- ALL CONDUITS FOR UNDERGROUND AND EMBEDDED WIRING SHALL BE POLYVINYL CHLORIDE(PVC). FOR EXPOSED WIRING SHALL BE INTERMEDIATE METALLIC CONDUIT (IMC).
- CONDUITS SHALL BE PROTECTED AGAINST DAMAGES BY THE ENTRANCE OF WATER AND FOREIGN MATTERS DURING CONSTRUCTION. ALL ENDS OF CONDUITS SHALL BE PLUGGED TO EXCLUDE MOISTURE AND DUST IMMEDIATELY AFTER THE CONDUITS ARE PLACED.
- METHOD OF WIRING SHALL BE AS FOLLOWS:
  - A. POWER & LIGHTING
  - B. TELEPHONE, CATV AND CCTV SYSTEM
  - C. FIRE ALARM SYSTEM
  - D. POWER FEEDER & SUB-FEEDER
- ALL RACEWAYS, WALL AND FLOOR PENETRATIONS SHALL BE PROVIDED WITH FIRE BARRIER OF THE APPROVED TYPE.
- UNLESS OTHERWISE SPECIFIED, THE MINIMUM SIZE OF WIRE SHALL BE 3.5mm<sup>2</sup> THHN AND CONDUIT SHALL BE 15 mm<sup>2</sup>RSC AND 20 mm<sup>2</sup>PVC.
- ALL WIRES AND CABLES SHALL BE UL-LISTED, AS MANUFACTURED BY PHELPS DODGE OR APPROVED EQUAL AND SHALL BE COLOR-CODED AS FOLLOWS:
 

A. LINE 1	RED
B. LINE 2	YELLOW
C. LINE 3	BLUE
D. NEUTRAL	WHITE
E. GROUND	GREEN
- PROVIDE ADEQUATE & EFFECTIVE GROUNDING SYSTEM TO ALL LIGHTING AND POWER CIRCUIT AS PER PHILIPPINE ELECTRICAL CODE REQUIREMENT.
- CONVENIENCE OUTLET & LIGHTING SWITCHES SHALL BE RATED AT 20 A, 240 V, & 15 A, 240 V, RESPECTIVELY AS MANUFACTURED BY NATIONAL OR APPROVED EQUAL.
- ALL CONVENIENCE OUTLETS SHALL BE OF GROUNDING TYPE. PROVIDE GROUND FAULT CIRCUIT INTERRUPTER(GFCI) TO CIRCUITS WITH WEATHERPROOF OUTLETS.
- ALL OUTLET BOXES SHALL BE GALVANIZED GAGE NO. 16, DEEP TYPE WITH FACTORY KNOCKOUTS.
- ALL JUNCTIONS BOXES THAT ARE EXPOSED TO WEATHER SHALL USE WEATHERPROOF TYPE OF ENCLOSURE.
- PULLBOXES SHALL BE USED WHEN APPLICABLE FOR EASY PULLING OF WIRES AND SHALL BE ACCORDING TO CODE REQUIREMENT.
- ALL FLUORESCENT BALLAST SHALL BE ELECTRONIC TYPE AND ENCLOSED IN METALLIC BOX.
- ALL ELECTRICAL PANELBOARD AND CIRCUIT BREAKERS SHALL BE 'SCHNEIDER' OR 'APPROVED EQUAL' AND SHALL BE BOLT-ON TYPE.
- ALL ELECTRICAL CIRCUITS SHALL BE WIRED ACCORDING TO THE PANELBOARD SCHEDULE.
- A REMOVABLE CIRCUIT DIRECTORY SHALL BE PROVIDED FOR EACH PANELBOARD FOR FIELD MARKING OF FUNCTION AND NUMBER OF EACH BRANCH CIRCUIT. ALL DIRECTORIES SHALL BE INCORRODIBLE MATERIAL WITH MATCHING CLEAR PLASTIC HOLDER OR JACKET.
- SAMPLE OF ELECTRICAL MATERIALS SHALL BE SUBMITTED TO THE CONSULTANT FOR APPROVAL PRIOR TO INSTALLATION. ANY MATERIALS INSTALLED NOT CONFORMING TO THE PLANS AND SPECIFICATIONS SHALL BE REMOVED IMMEDIATELY. THE CONTRACTOR SHALL SUBMIT WRITTEN REQUEST FOR APPROVAL OR ANY SUBSTITUTION OF EQUIVALENT MATERIALS.
- CONTRACTORS MUST SUBMIT SHOP DRAWINGS OF ALL PULLBOX, GUTTERS, AND PANELBOARDS TO ENGINEER PRIOR TO FABRICATION.
- MOUNTING HEIGHTS OF DEVICES SHALL BE AS APPROVED BY THE ARCHITECT AND/OR AS FOLLOWS:
 

A. PANELBOARD	1.40M CENTER OF THE FINISH FLOOR
B. SWITCH	1.40M ABOVE FINISHED FLOOR TO CENTER OF DEVICE
C. CONVENIENCE OUTLET	0.30M ABOVE FINISHED FLOOR TO CENTER OF DEVICE
D. COUNTER HEIGHT C.O.	0.20M FROM FINISHED COUNTER HEIGHT LINE TO THE CENTER OF DEVICE
E. EMERGENCY LIGHT	0.30M BELOW CEILING TO CENTER OF DEVICE
F. FIRE EXIT LIGHT	0.30M BELOW CEILING TO CENTER OF DEVICE
G. FIRE ALARM PULL STATION	1.40M ABOVE FINISHED FLOOR TO CENTER OF DEVICE
H. ANNUNCIATOR	0.30M BELOW CEILING TO CENTER OF DEVICE
I. TELEPHONE FIREMAN'S JACK	1.30M ABOVE FINISHED FLOOR TO CENTER OF DEVICE
J. HORN WITH STROBE LIGHT	0.30M BELOW CEILING TO CENTER OF DEVICE

ALL MOUNTING HEIGHTS ARE SUBJECT FOR ARCHITECT'S APPROVAL PRIOR TO INSTALLATION.
- THE PLANS AS DRAWN ARE BASED UPON THE ARCHITECTURAL PLANS AND THE DETAILS AND SHOWN CONDITION AS APPEARING THEREIN. IT IS POSSIBLE TO INDICATE THEM IN SCALE. THE PLANS ARE DIAGRAMMATICAL AND DO NOT NECESSARILY SHOW ALL FITTINGS NECESSARY TO FIT TO THE BUILDING CONDITIONS. THE LOCATIONS OF OUTLETS, APPARATUS AND APPLIANCE SHOWN ON THE PLANS ARE APPROXIMATE. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR THEIR PROPER LOCATION IN ORDER TO MAKE THEM FIT WITH THE ARCHITECTURAL DETAILS AND INSTRUCTIONS FROM THE ENGINEER'S REPRESENTATIVE AT THE SITE.
- UPON COMPLETION OF ELECTRICAL CONSTRUCTION WORK, THE FOLLOWING TESTS SHALL BE PERFORMED BY THE CONTRACTOR INCLUSIVE OF THE INSTALLATION TO BE REPORTED IN DETAILS AND IN FORMS APPROVED BY THE OWNER'S REPRESENTATIVE:
  - A. INSULATION RESISTANCE TEST
  - B. GROUND RESISTANCE TEST
  - C. OPERATIONAL TEST
  - D. PHASE BALANCING TEST
  - E. PHASE SEQUENCE TEST
  - F. SYSTEM TEST
- VERIFY ACTUAL LOCATION OF ALL MOTORS, SEE MECHANICAL AND SANITARY PLANS
- ACTUAL LOCATION AND SIZE OF FUEL DAY TANK IS SUBJECT TO MECHANICAL ENGINEER.
- WIRING FOR FIRE PUMP SHALL BE PERMITTED TO BE ROUTED THROUGH A BUILDING(S) ENCASED IN 50MM OF CONCRETE, OR WITHIN ENCLOSED CONSTRUCTION DEDICATED TO THE FIRE PUMP CIRCUIT(S) AND A HAVING A MINIMUM OF 1-HOUR FIRE RESISTANCE.
- MINIMUM HEADROOM OF WORKING SPACES ABOUT SERVICE EQUIPMENT, SWITCHBOARDS, PANELBOARDS, OR MOTOR CONTROL CENTERS SHALL BE 2.0 METERS, WHERE THE ELECTRICAL EQUIPMENT EXCEEDS 2.0 METERS IN HEIGHT, THE MINIMUM HEADROOM SHALL NOT BE LESS THAN THE HEIGHT OF THE EQUIPMENT.
- VERIFY VOLTAGE DROP DUE TO ACTUAL ROUTE OF CIRCUIT HOMERUN.
- ALL SHOP DRAWINGS NOT INDICATED IN THE PLANS SHALL BE PROVIDED BY THE CONTRACTOR AND SUBJECT TO OWNER REPRESENTATIVE'S APPROVAL BEFORE INSTALLATION.
- ALL MATERIALS TO BE USED SHALL BE NEW AND OF THE APPROVED TYPE FOR THE LOCATION AND PURPOSE.
- PANELBOARD OF RESIDENTIAL UNIT SHALL BE LOCATED INSIDE THE CABINET, SUBJECT TO ARCHITECT'S APPROVAL.


**EE-01 LEGENDS**

- 600mm X 600mm TROFFER LIGHTING FIXTURE WITH 4-18W COOL DAYLIGHT LED TUBE (AS PER APPROVED BY ARCHITECT)
- 600mm X 600mm LED PANEL LIGHT (AS PER APPROVED BY ARCHITECT)
- 1200mm SUSPENDED LED LIGHTING FIXTURE COMPLETE WITH ELECTRONIC BALLAST AND 1 x 20 WATTS TLED LAMP. (AS PER APPROVED BY ARCHITECT)
- 1200mm SUSPENDED LED LIGHTING FIXTURE COMPLETE WITH ELECTRONIC BALLAST AND 2 x 20 WATTS TLED LAMP. (AS PER APPROVED BY ARCHITECT)
- TRACK LIGHT (AS PER APPROVED BY ARCHITECT)
- 1 x 18 WATTS LED DOWNLIGHT. (AS PER APPROVED BY ARCHITECT)
- LED STRIP OR TLED LAMP. (AS PER APPROVED BY ARCHITECT)
- LAMP POST, THEOS 70, LED 35W, 4000K, 4304 lm DIE-CAST ALUMINUM BODY HOUSING AND POST (SM HT.) PAINTED BLACK, IP66 (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- SURFACE MOUNTED LIGHT, MIMIK 20 FLAT B, IP 65, CLASS I, LED, POLYESTER POWDER-PAINTED, DIE-CAST ALUMINUM HOUSING, SILICON GASKET, 220/240V 50/60HZ WITH SAFETY TRANSFORMER. (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- STEP LIGHT INSERT +1, LED 6W, 3000K, DIE-CAST ALUMINUM BODY, ANTI-CORROSION TREATMENT, IP65 (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- BOLLARD LIGHT KHA SLIM 93 LED C/EW, 11.5W, CLASS II, IP66, 3000K, EXTRA PURE POLISHED ALUMINUM REFLECTORS, LIGHT SOURCE LUMEN OUTPUT: 914LM, LUMINAIRE LUMEN OUTPUT: 182LM, LIFETIME: 50000H, PERCENT LUMEN DEPRECIATION: L70 (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- UPLIGHT, PIXIE GROUND MINI, LED 15W, 3000K, DIE-CAST ALUMINUM BODY, TURNABLE ON 1 AXIS, ANTI-CORROSION TREATMENT, IP54 (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- SPOT LIGHT, GUELL 1A/W, LED 53W, 4000K, DIE-CAST ALUMINUM BODY, TURNABLE ON 1 AXIS, ANTI-CORROSION TREATMENT, IP66 (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- WALL LIGHT, TWIST WALL, LED 10W, 3000K, DIE-CAST ALUMINUM BODY, ANTI-CORROSION TREATMENT, IP54 (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- CEILING PIN LIGHT, VENN SUSPENDED, 370/2100 LUMENS, 47W, 2700K, CR80, 220-240VAC 50-60Hz, IP20, ALUMINUM POWDER COATED, OPAL PMMA COVER 1 DIRECT/ INDIRECT (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- RECESSED WALL LIGHT, INSERT +2, LED 10W, BLACK, INSULATION CLASS I, IP65, 3000K, OPTIC: ASYMMETRIC WIDE REFLECTOR, LIGHT SOURCE LUMEN OUTPUT: 1170LM, LUMINAIRE LUMEN OUTPUT: 430LM, LIFETIME: 60000H, PERCENT LUMEN DEPRECIATION: L80 (AS PER APPROVED BY LANDSCAPE ARCHITECT)


- UNDER WATER LIGHT, WATER JET, INTEGRATED WATER JET (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- FLOOD LIGHT, GUELL 2.5, LED 166W, 5000K, 220-240V, 20915LM, 3PCS FLOOD LIGHT PER POST, ANTI-CORROSION TREATMENT, IP66, CRI 65
- POST: DIE-CAST ALUMINUM BODY (8.0M HT.) DOUBLE CROSS BAR POST IN HOT DIP GALVANIZED (AS PER APPROVED BY LANDSCAPE ARCHITECT)
- EXIT SIGN, MAINTAINED TYPE COMPLETE WITH 2.4 VOLTS, 4AH NICKEL CADMIUM CELL, BATTERY BACK-UP, INVERTED BATTERY PROTECTION, 16 HOURS RE-CHARGED PERIOD, CONSTANT CURRENT CHARGER ARROW DENOTES DIRECTION.
- BATTERY OPERATED EMERGENCY LIGHT FOR INDUSTRIAL APPLICATION POWDER COATED PAINT FINISH, COMPLETE WITH NICKEL CADMIUM CELLS, RED LED INDICATOR, PUSH TEST SWITCH, BATTERY PROTECTION, 30 MINUTES MINIMUM OPERATING TIME AND AUTOMATIC RE-CHARGING WITH SIMPLEX CONVENIENCE OUTLET, 3-PRONG, 15A, UNIVERSAL TYPE.
- TUMBLER SWITCH, NUMBER DENOTES NUMBER OF GANG IN A PLATE, SMALL LETTERS DENOTE LIGHTS CONTROLLED, "3W" DENOTES 3-WAY SWITCH.
- WALL MOUNTED DUPLEX CONVENIENCE OUTLET, 15A, PARALLEL SLOTS, GROUNDING TYPE, "GFCI" DENOTES GROUND FAULT CIRCUIT INTERRUPTER, "R/RH" DENOTES RANGE/RANGE HOOD.
- WALL MOUNTED SIMPLEX CONVENIENCE OUTLET, 15A, PARALLEL SLOTS, GROUNDING TYPE, "GFCI" DENOTES GROUND FAULT CIRCUIT INTERRUPTER, "HD" DENOTES HAND DRYER, "REF" DENOTES REFRIGERATOR, "MO" DENOTES MICROWAVE OVEN.
- FLOOR/TABLE MOUNTED DUPLEX CONVENIENCE OUTLET, 15A, PARALLEL SLOTS, GROUNDING TYPE.
- WALL MOUNTED SPECIAL PURPOSE OUTLET, "WH" DENOTES WATER HEATER, OR AS INDICATED.
- JUNCTION BOX FOR POWER PROVISION, "P" DENOTES PROJECTOR, "CF" DENOTES CEILING FAN, "CEF" DENOTES CEILING EXHAUST FAN, "TEF" DENOTES TOILET EXHAUST FAN, OR AS INDICATED.
- OCCUPANCY SENSOR
- ENCLOSED CIRCUIT BREAKER, RATING AS INDICATED
- DISTRIBUTION PANEL / POWER & LIGHTING PANEL
- CONDUIT RUN EMBEDDED OR CONCEALED IN CONCRETE FLOOR SLAB OR WALL
- CONDUIT BRANCH CIRCUIT HOMERUN TO PANELBOARD
- CIRCUIT HOMERUN DESIGNATION, UPPER PART DENOTES POWER SOURCE OF THE CIRCUIT WHILE LOWER HALF DENOTES CIRCUIT DESIGNATION.

**EE-01 DRAWING INDEX**

SHEET NO.	SHEET CONTENT
EE-01	GENERAL NOTES, LEGENDS, VICINITY MAP, DRAWING INDEX, SITE DEVELOPMENT PLAN
EE-02	BASEMENT LIGHTING SYSTEM LAYOUT
EE-03	BASEMENT POWER SYSTEM LAYOUT
EE-04	1F LIGHTING SYSTEM LAYOUT
EE-05	1F POWER SYSTEM LAYOUT
EE-06	2F LIGHTING SYSTEM LAYOUT
EE-07	2F POWER SYSTEM LAYOUT
EE-08	TYPICAL 3F TO 5F LIGHTING SYSTEM LAYOUT
EE-09	TYPICAL 3F TO 5F POWER SYSTEM LAYOUT
EE-10	6F LIGHTING SYSTEM LAYOUT
EE-11	6F POWER SYSTEM LAYOUT
EE-12	7F LIGHTING SYSTEM LAYOUT
EE-13	7F POWER SYSTEM LAYOUT
EE-14	8F & 9F LIGHTING SYSTEM LAYOUT
EE-15	8F & 9F POWER SYSTEM LAYOUT
EE-16	10F & 11F LIGHTING SYSTEM LAYOUT
EE-17	10F & 11F POWER SYSTEM LAYOUT
EE-18	12F & 14F LIGHTING SYSTEM LAYOUT
EE-19	12F & 14F POWER SYSTEM LAYOUT
EE-20	15F & 16F LIGHTING SYSTEM LAYOUT
EE-21	15F & 16F POWER SYSTEM LAYOUT
EE-22	17F & 18F LIGHTING SYSTEM LAYOUT
EE-23	17F & 18F POWER SYSTEM LAYOUT
EE-24	19F & 20F LIGHTING SYSTEM LAYOUT
EE-25	19F & 20F POWER SYSTEM LAYOUT
EE-26	21F & 22F LIGHTING SYSTEM LAYOUT
EE-27	21F & 22F POWER SYSTEM LAYOUT
EE-28	23F & 24F LIGHTING SYSTEM LAYOUT
EE-29	23F & 24F POWER SYSTEM LAYOUT
EE-30	ROOF DECK POWER SYSTEM LAYOUT
EE-31	GF MECHANICAL POWER SYSTEM LAYOUT
EE-32	7F MECHANICAL POWER SYSTEM LAYOUT
EE-33	8F & 9F MECHANICAL POWER SYSTEM LAYOUT
EE-34	10F & 11F MECHANICAL POWER SYSTEM LAYOUT
EE-35	12F & 14F MECHANICAL POWER SYSTEM LAYOUT
EE-36	15F & 16F MECHANICAL POWER SYSTEM LAYOUT
EE-37	17F & 18F MECHANICAL POWER SYSTEM LAYOUT
EE-38	19F & 20F MECHANICAL POWER SYSTEM LAYOUT
EE-39	21F & 22F MECHANICAL POWER SYSTEM LAYOUT
EE-40	23F & 24F MECHANICAL POWER SYSTEM LAYOUT
EE-41	GF GROUNDING SYSTEM LAYOUT
EE-42	LIGHTNING PROTECTION SYSTEM LAYOUT
EE-43	SCHEDULE OF LOADS (SHEETS A TO G)
EE-44	POWER RISER DIAGRAM
EE-45	MISCELLANEOUS DETAILS

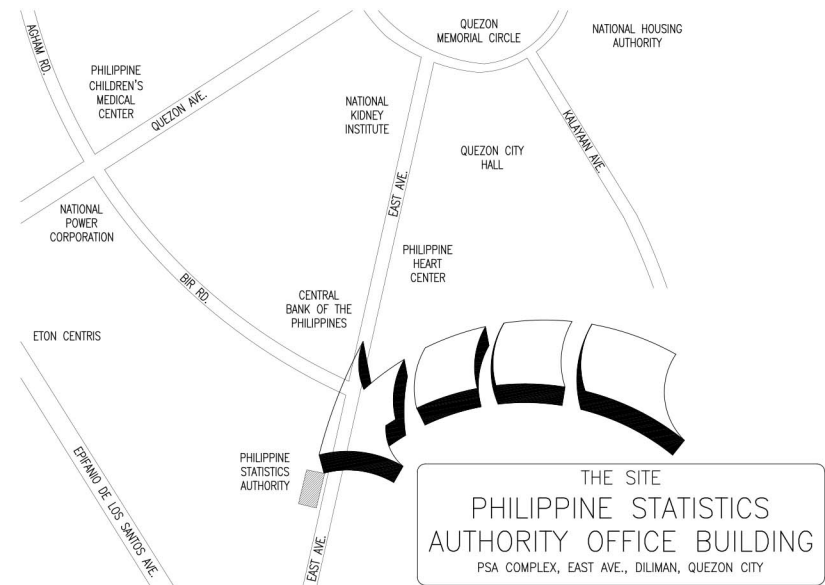

**EE-01 VICINITY MAP**  
NOT TO SCALE

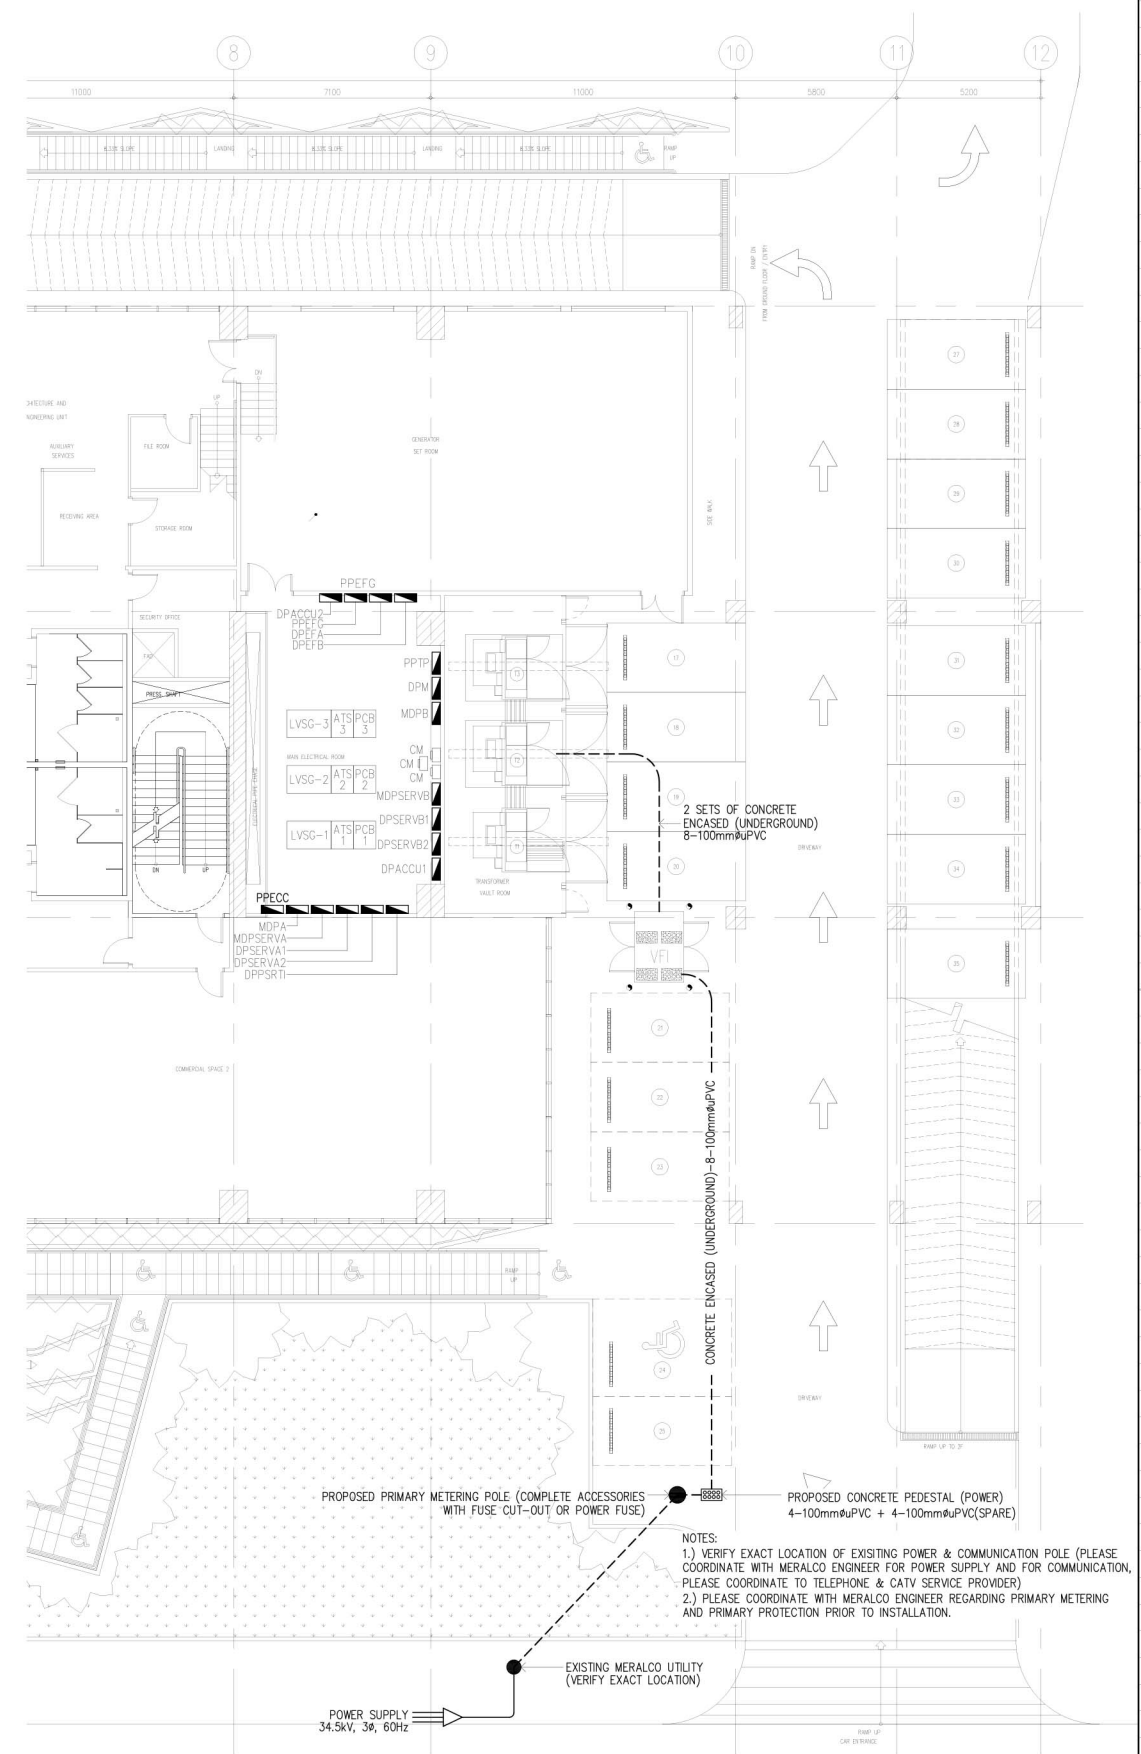

**EE-01 SITE DEVELOPMENT PLAN**  
NOT TO SCALE

**NOTE:**  
PURSUANT TO SECTION 4 OF ANNEX "A" OF THE REVISED IMPLEMENTING RULES AND REGULATIONS OF R.A. 9164, APPROVED BY THE BOARD OF PROFESSIONAL ENGINEERS SURVEYS AND DESIGN UNDER THE SUPERVISION OF THE REGISTERED ELECTRICAL ENGINEER, THE RESPONSIBILITY OF THE LATTER FOR THE TECHNICAL INTEGRITY OF THE SURVEYS AND DESIGN NOT TRANSFER ANY PART OF THE RESPONSIBILITY TO THE APPROVING OFFICIALS.  
THE DESIGN CONSULTANT SHALL BE HELD RESPONSIBLE FOR THE FAILURE OF THE FACILITY/ES / STRUCTURES DUE TO FAULTY DESIGN EXCEPT FOR THE CHANGES MADE WITHOUT THE CONFORMITY OF THE CONSULTANTS.

 Suite 205, Zoroaster Square Condominium, 4038 Alvarado Ave. Loyola Heights, Quezon City Tel No. (832) 867-8069 Email: tokwingcon@ yahoo.com.ph	 ARCHITECTS ENGINEERS CONSULTANTS Suite 205, Zoroaster Square Condominium, 4038 Alvarado Ave. Loyola Heights, Quezon City Tel No. (832) 7917-5358 Email: enocon@ yahoo.com.ph	CONSULTANT: MANUEL V. PANIS PROFESSIONAL ELECTRICAL ENGINEER REG. NO. : 02120 VALUITY : 10/13/2023 PRC NO. : 8144987 DATE : 01/03/2022 PLACE : ANTIPOLO CITY TN NO. 132-466-222	CHECKED: JOSE MANUEL AGUILARDO PROJECT MANAGER & BUILDING & SPECIAL PROJECTS MANAGEMENT CLUSTER UNIFIED PROJECT MANAGEMENT OFFICE, DPWH	REVIEWED: ATTY. JOHNSON V. DOMINICO DIRECTOR BUILDING & SPECIAL PROJECTS MANAGEMENT CLUSTER UNIFIED PROJECT MANAGEMENT OFFICE, DPWH	RECOMMENDING APPROVAL: REYNOR R. IMPERIAL DIRECTOR PLANNING AND MANAGEMENT SERVICE CO-HEAD, PSA-BCOM	APPROVED: SOCRATES L. RAMOS DIRECTOR FINANCE AND ADMINISTRATIVE SERVICE HEAD, PSA-BCOM	APPROVED: LEO B. MALAGAR ASSISTANT REGISTERED ELECTRICAL ENGINEER DEPUTY NATIONAL STATISTICIAN CIVIL REGISTRATION & CENTRAL SUPPORT OFFICE	APPROVED: USEC. CLAIRE DENNIS S. MAPA, PH. D. NATIONAL STATISTICIAN AND CIVIL REGISTRAR GENERAL PHILIPPINE STATISTICS AUTHORITY	PROJECT: CONSTRUCTION OF FIT-OUT AND LANDSCAPE WORKS FOR THE TWENTY-THREE (23) STOREY PHILIPPINE STATISTICS AUTHORITY (PSA) OFFICE BUILDING WITH COVERED ROOF DECK LOCATION: PSA COMPLEX, EAST AVENUE, DILIMAN, QUEZON CITY	SHEET CONTENT: GENERAL NOTES, LEGENDS, VICINITY MAP, DRAWING INDEX, SITE DEVELOPMENT PLAN	DESIGNER: LJC CAD: LPC CHECKED: MVP DATE: FEB. 2022	REVISIONS: SYMBOL, REMARK, DATE	SHEET NO.: EE-01
--	---	---	--	--	---	---	---	--	--	---	--	---------------------------------	------------------